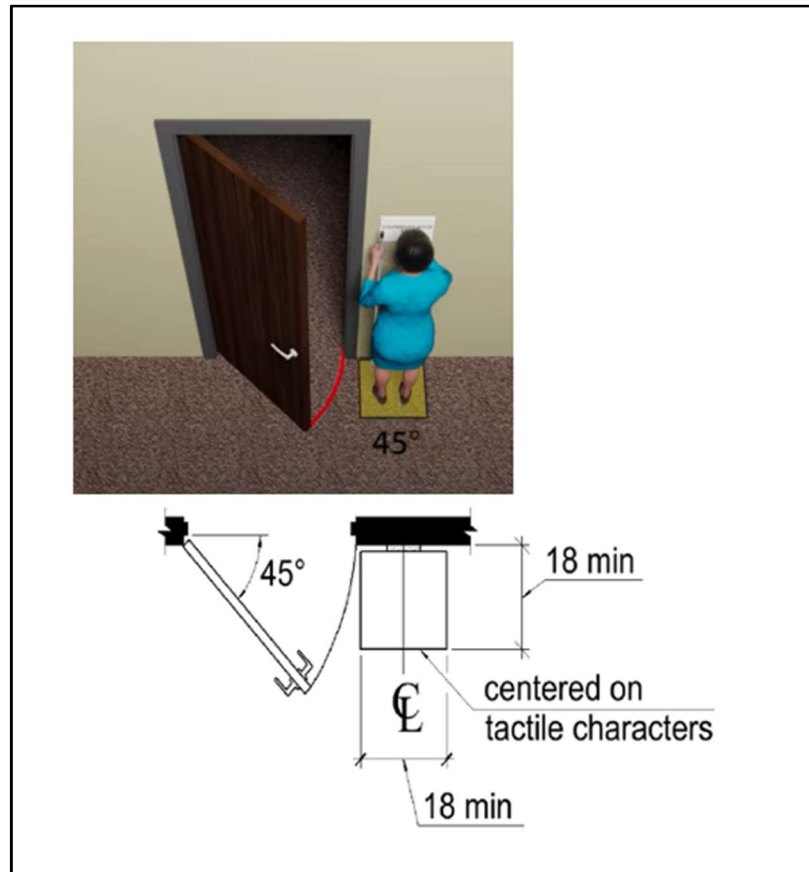


## Section 5: Signage


Questions	Yes	No	N/A	Dimension (As-Built)	Modifications / Notes
1. Do permanently named rooms and spaces (only those areas identified for use on Election Day) have signs with room names or numbers in raised characters and Braille?					
2. Are the signs installed on the wall adjacent to the latch side of the door? If there is no wall space on the latch side of the door, are signs placed on the nearest adjacent wall?					
3. Are tactile signs placed so the lowest part of the Braille cell is at least 48 inches or higher above the floor?				Low height:	
4. Is the top row of raised characters placed no more than 60 inches above the floor measured from the bottom of the raised characters?				Top height:	
5. Can a voter approach the signs without bumping into protruding objects or standing/wheeling within the swing of a door with a clear floor space of 18 inches by 18 inches that is centered on the tactile characters? (See figure.)				Distance:	

Questions	Yes	No	N/A	Dimension (As-Built)	Modifications / Notes
6. Do signs have a non-glare finish? (Including directional and informational permanent and temporary signage.)					
7. Do signs have character and symbol colors that contrast with the background color?  (Dark on light or light on dark)					
8. Is an ISA provided to identify facilities and features that are intended for use by and provided to elderly voters and people with disabilities?					

**Figure for Clear Floor Space**



**Figure for additional Braille Signs**

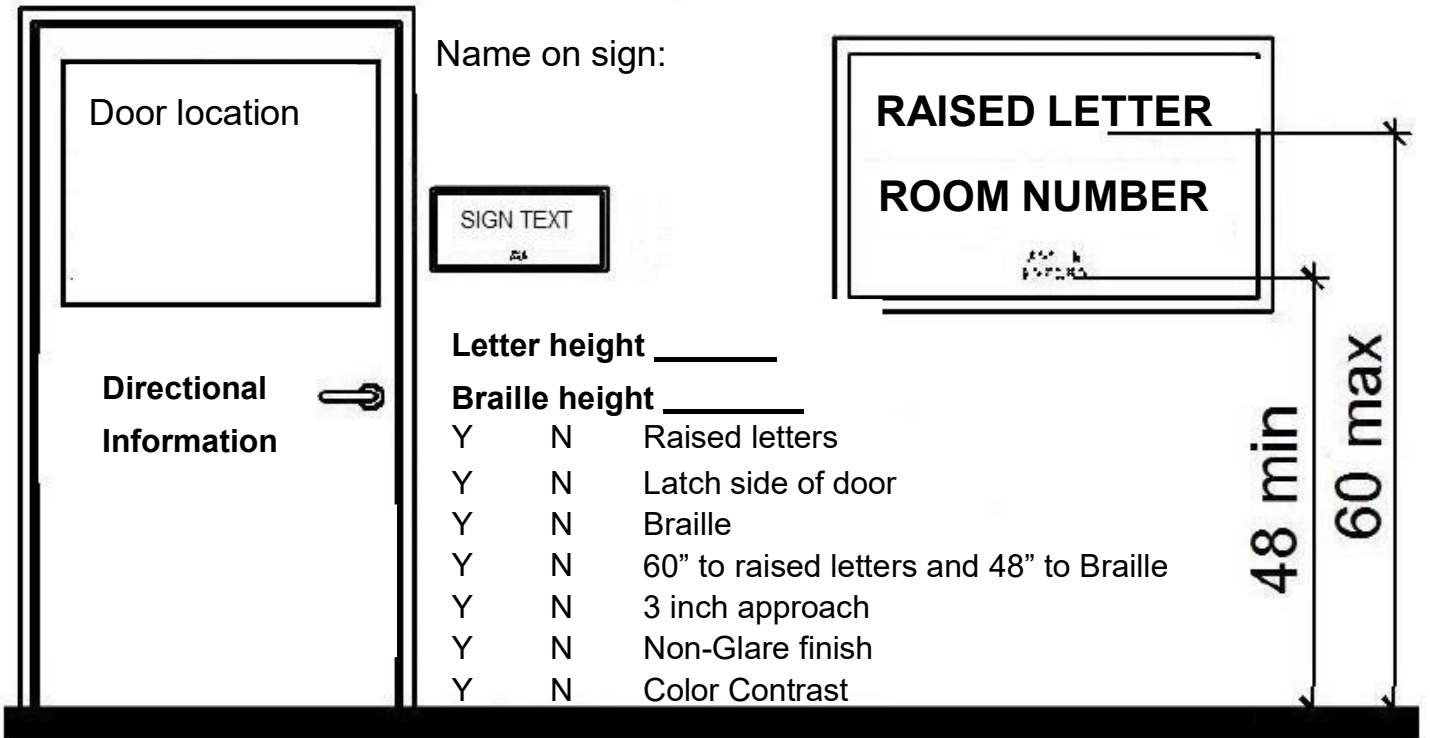

**Modifying measures needed at this site on Election Day:**

- Directional signs needed
  - \_\_\_ Left pointing signs needed
  - \_\_\_ Right pointing signs needed
- Additional laminate signs needed
- Other

Comments: